


Vent connections are provided on the SAF tank turrets, to allow connection to the site's venting system. The design of the venting system will vary from site to site and is the responsibility of the installation contractor.

1	15/03/10	RP	RU	RP	ISSUED FOR INFO												
REV.	DATE	BY	CHKD.	APPD.	DESCRIPTION												
<p>GENERAL TOLERANCES (unless noted otherwise)</p> <table border="1"> <tr> <td>GRP FABRICATED MACHINED</td> <td>LINER</td> <td>± 5mm</td> <td>± 2mm</td> <td>± 0.5mm</td> <td>± 0.2°</td> </tr> <tr> <td></td> <td></td> <td>± 0.5mm</td> <td></td> <td></td> <td>± 0.1°</td> </tr> </table>						GRP FABRICATED MACHINED	LINER	± 5mm	± 2mm	± 0.5mm	± 0.2°			± 0.5mm			± 0.1°
GRP FABRICATED MACHINED	LINER	± 5mm	± 2mm	± 0.5mm	± 0.2°												
		± 0.5mm			± 0.1°												
<p>IMPORTANT INVERT LEVEL NOTE (RIBBED TANKS ONLY): The inlet and outlet invert levels shown on this drawing is to the outside of the shell unless otherwise stated. For invert level to the outside of the shell, ribs, see the conversion below:</p> <table border="1"> <tr> <td>Ø3.0m, 4.0m</td> <td>IL+50mm (X1)</td> </tr> <tr> <td>Ø3.0m, 4.0m</td> <td>IL+50mm (X1)</td> </tr> </table>						Ø3.0m, 4.0m	IL+50mm (X1)	Ø3.0m, 4.0m	IL+50mm (X1)								
Ø3.0m, 4.0m	IL+50mm (X1)																
Ø3.0m, 4.0m	IL+50mm (X1)																
<p>TANKS SUPPLIED WITH LOOSE SHAFTS DO NOT COME SUPPLIED WITH A FIXING KIT. THIS IS THE RESPONSIBILITY OF THE SITE CONTRACTOR.</p>																	

TITLE					
NSAF50 SCHEME SHOWING TYPICAL KIOSK CONNECTIONS					
DRAWN BY	CHKD.	APPD.	SCALE	DRAWING No.	REVISION
RP	RU	RP	NTS	NSAF50 LAYOUT	1
DATE	DATE	DATE			
15/03/10	15/03/10	15/03/10			

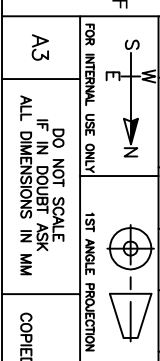

DO NOT SCALE
 IF IN DOUBT ASK
 ALL DIMENSIONS IN MM

THIS DRAWING IS THE PROPERTY OF
 CONDER SOLUTIONS LTD. AND IS NOT TO BE
 COPIED IN PART OR WHOLE WITHOUT WRITTEN PERMISSION

FOR INTERNAL USE ONLY

15/03/10